


pupillary dist= 0.9005 ± 0.0010

Re(phase1)= 144.54 ± 2.67

Re(phase2)= 144.54 ± 2.67

Im(phase2)= 0.56 ± 0.97

- Data
- Fit
- Amplitude 1
- Amplitude 2

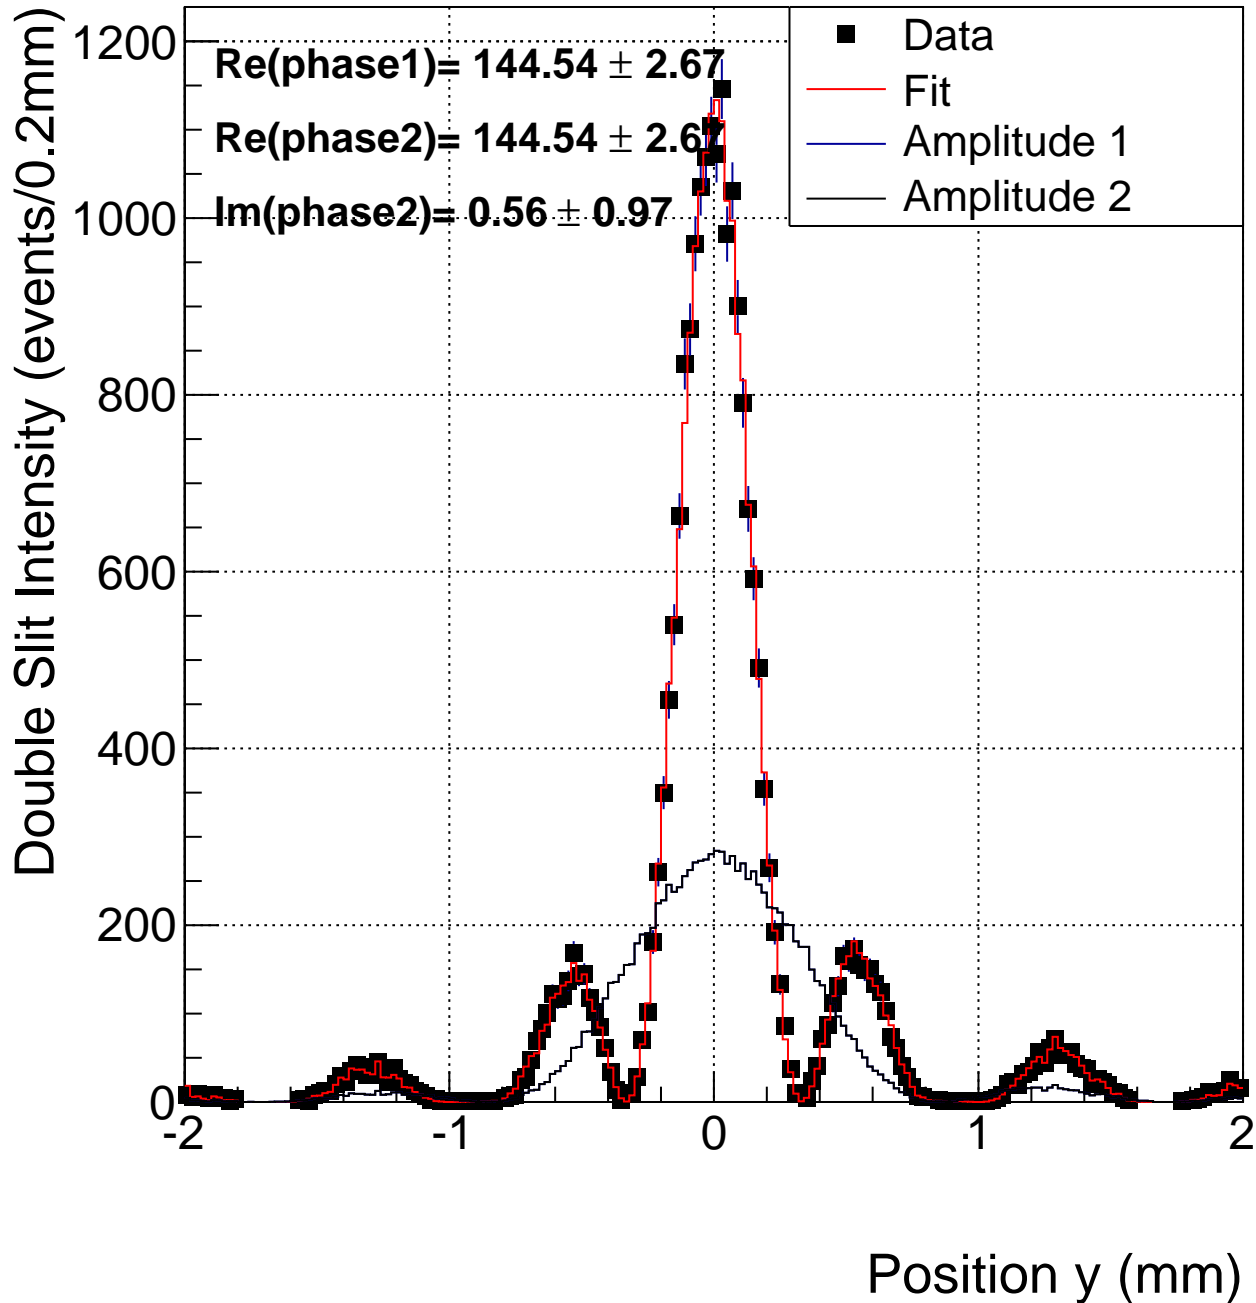

pupillary dist= 0.9005 ± 0.0010

Re(phase1)= 144.54 ± 2.67

Re(phase2)= 144.54 ± 2.67

Im(phase2)= 0.56 ± 0.97

